

**TECHNICAL DATASHEET**



**Pressure transmitter  
CP 100**



- Differential pressure transmitter type CP100
- Measuring ranges from 0/+100 Pa to -1000/+2000 mbar (according to model, see "Configuration")
- Configurable intermediary and central zero ranges
- 0-10 V or 4-20 mA output, active sensor, power supply 24 Vac/Vdc (3-4 wires) or 4-20 mA output, passive loop, power supply 18 to 30 Vdc (2 wires)
- ABS IP 65 housing, with or without display
- Quick and easy mounting with the "¼ turn" system with wall-mount plate

**Part number**

To order, just add the codes to complete the part number.

**Measuring range**

1	-500/+1000 Pa	For the intermediary and central zero ranges, see "Configuration".
2	-500/+1000 mmH <sub>2</sub> O	
3	-250/+500 mbar	
4	-1000/+2000 mbar	

**Transmitter / power supply / output**

A	Active • 24 Vac/Vdc • 0-10V or 4-20 mA
P	Passive • 18/30 Vdc • 4-20 mA

**Display**

O	With display
N	Without display




Example : CP103-AO

Model : pressure transmitter CP100, measuring range -250/+500 mBar, active sensor, 0-10 V or 4-20 mA output, with display.

**Dimensions of the housing**

(including the wall-mount plate)

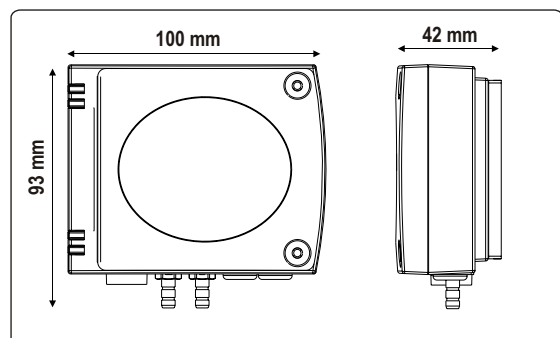

**Features of the transmitter**

**Pressure**

Working principle : a piezoresistive sensitive element creates a proportional voltage from the pressure applied on the sensor.

Measuring range ..... see "Part number"

Unit of measurement ..... Pa, mmH<sub>2</sub>O, mbar, inWG, mmHG (CP101 and CP102)  
mbar, inWG, mmHG, KPa, PSI (CP 103 and CP 104)

Accuracy\* ..... ±1,5% of reading ± 3 Pa (CP 101)  
±1,5% of reading ± 3 mmH<sub>2</sub>O (CP102)  
±1,5% of reading ± 3 mbar (CP103 and CP104)

Response time ..... 1/e (63%) 0,3 sec.

Resolution ..... 1 Pa - 0,1 mmH<sub>2</sub>O - 0,01 mbar - 0,01 inHG (CP 101 and CP102)  
0,01mbar - 0,01 inWG - 0,01 mmHG - 0,1 KPa - 0,1 PSI (CP 103 and CP104)

Autozero ..... manual with push-button

Type of fluid ..... air and neutral gases

Overpressure tolerated ..... 25000 Pa (CP 101), 7000 mmH<sub>2</sub>O (CP 102),  
1400 mbar (CP 103), 3000 mbar (CP 104).

**Features of the housing**

WITH or WITHOUT display

Housing ..... ABS

Fire-proof classification ..... HB as per UL94

Dimensions ..... see drawing beside

Protection ..... IP 65

Display ..... 5-digit LCD. Dimensions 50 x 15 mm

Height of the digits ..... 10 mm

Connections ..... barbed fittings Ø 5,2mm (CP 101 and CP 102)  
compression fittings Ø 4x6mm (CP 103 and CP 104)

Cable grip ..... for cable Ø 7mm max.

Weight ..... 145g (with display) - 110g (without display)



**Technical Specifications**

Output / Power supply ..... active sensor 0-10V or 4-20mA (power supply 24Vac/Vdc ± 10%), 3-4 wires  
passive loop 4-20 mA (power supply 18/30 Vdc), 2 wires  
maximum load : 500 Ohms (4-20 mA)  
minimum load : 1 K Ohms (0-10 V)

Consumption ..... 2 VA (0-10V) or max. 22 mA (4-20mA)

Electro-magnetical compatibility ... EN 61326

Electrical connection ..... screw terminal block for cables Ø 1.5 mm<sup>2</sup> max

Communication to PC ..... Kimo RS 232 cable

Working temperature ..... 0 to +50°C

Storage temperature ..... -10 to +70°C

Environment ..... air and neutral gases


\*All the accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

## Connection



For the models

**CP 101 102 - AO and CP 101 102 - AN • output 0-10 V or 4-20 mA - active**  
**103 104**

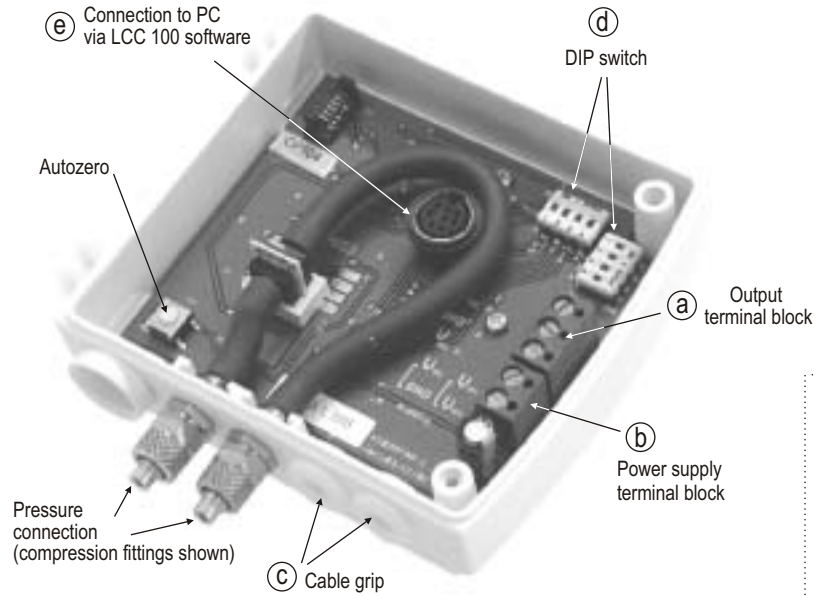

(c) Cable grip : to insert the cable, it is required to slightly cut the rubber.

### Output 0-10V

- (a)  GND .....ground  
 Vdc P.....direct voltage (pressure)

**OR**

### Output 4-20 mA

- (a)  Idc P .....direct current (pressure)  
 GND .....ground

### Direct power supply

- (b)  Vdc .....direct voltage  
 GND .....ground


**OR**

### Alternative power supply

- (b)  Vac.....alternative voltage (phase)  
 Vac.....alternative voltage (neutral)

For the models

**CP 101 102 - PO and CP 101 102 - PN • Output 4-20 mA - passive**  
**103 104**

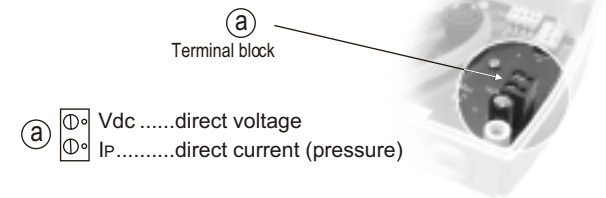


- (a)  Vdc .....direct voltage  
 IP.....direct current (pressure)

## Electrical connections - as per norm NFC15-100

**!** This connection must be made by a qualified technician. To make the connection, the transmitter must not be energized.


For the models

**CP 101 102 - AO and CP 101 102 - and • output 0-10 V or 4-20 mA - active**  
**103 104** **≡≡≡ 4 wires**

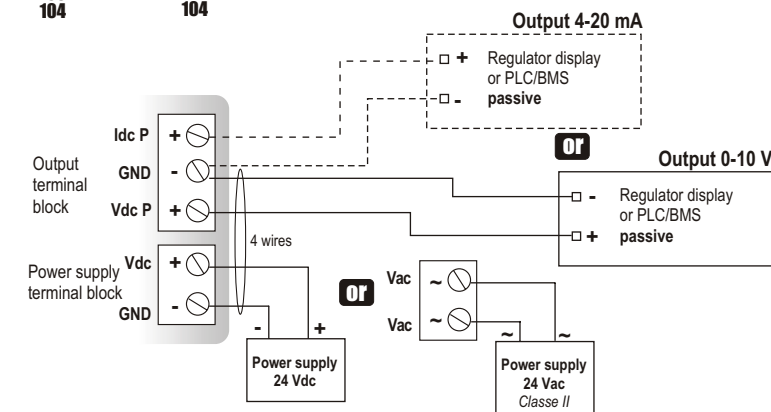


**≡≡≡ 3 wires**

**!** To make a 3-wire connection, before powering up the transmitter, please connect the output ground to the input ground. See drawing below.

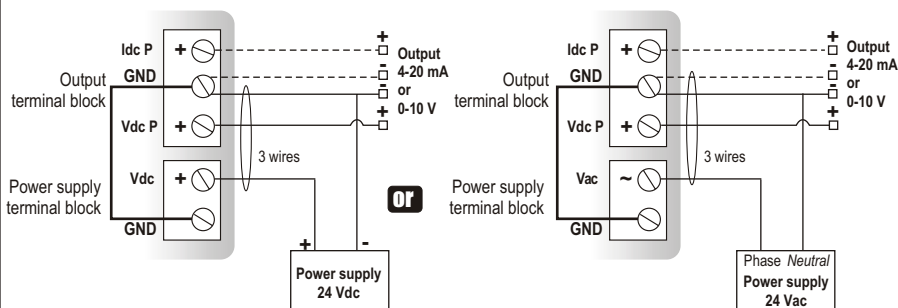


For the models

**CP 101 102 - PO and CP 101 102 - PN • output 4-20 mA - passive**  
**103 104** **≡≡ 2 wires**

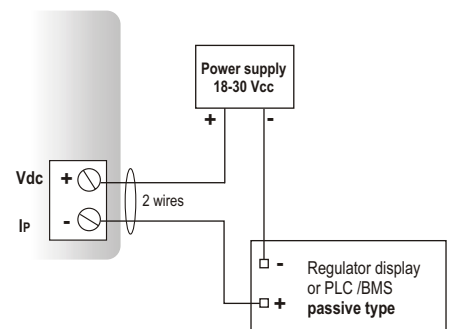

**OR**

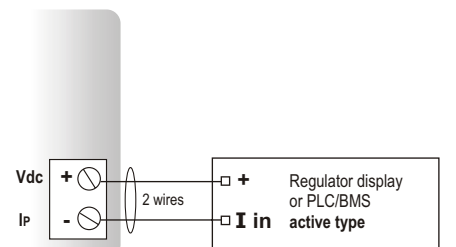

## Autozero

To make an autozero, please disconnect the 2 pressure connections and briefly press on the push-button.

## Configuration

It is possible to configure the measuring ranges, the units, the output of the instrument (according to the model) either by **switch** and/or via **software** (connections ③ and ④ on drawing "connection").

### Configuration by the DIP switch

To configure the instrument, please unscrew the 2 screws from the housing, and then open it.



To configure the transmitter, **it must not be energized**. Then, you can make the settings required, with the DIP switches (as shown on the drawing beside). When the transmitter is configured, you can power it up.


#### Caution !

Please follow carefully the combinations beside with the DIP switch.

If the combination is wrongly done, the following message will appear on the display of the transmitter "CONFERROR".

In that case, you will have to unplug the transmitter, place the DIP switches correctly, and then power the transmitter up.

#### Identification of the DIP switches on the electronic board

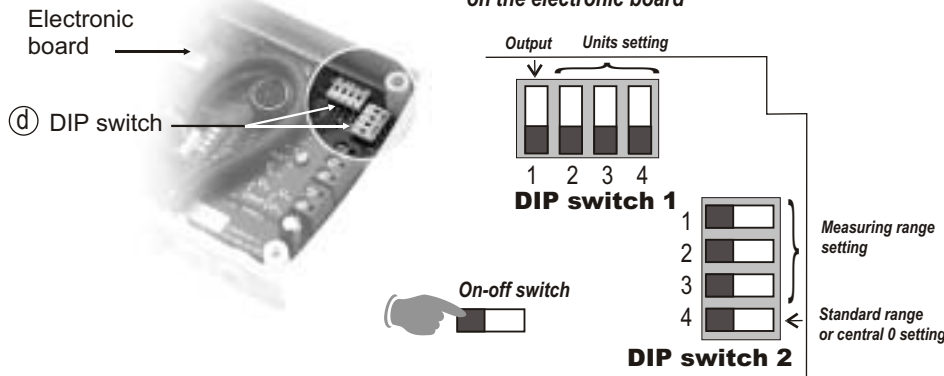

### Output setting DIP switch 1

To set the type of analogic output, please put the on-off switch of the output as shown beside. (For models CP 101 - AO and CP 101 - AN)

102	102
103	103
104	104

Configurations	4-20 mA	0-10 V
Combinations		
	1 2 3 4	1 2 3 4

### Units setting

#### DIP switch 1

To set the measuring unit, put the on-off switches 2,3 and 4 of units as shown beside.

Configurations	Pa	mmH <sub>2</sub> O	mbar	inWG	mmHG	KPa	PSI
Combinations							
	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4
CP101 and CP 102	X	X	X	X	X		
CP103 and CP 104			X	X	X	X	X

### Measuring range setting

#### DIP switch 2

To set the measuring range, put the on-off switches 1, 2 and 3 of the measuring range as shown beside.

Example :  
0 ----> +750 mmH<sub>2</sub>O, the measuring range is 750 mmH<sub>2</sub>O  
-500 Pa ----> +500 Pa, the measuring range is 1000 Pa

To configure other intermediary ranges, and for an easier and more friendly configuration, please refer to "Configuration via software".

Combinations	1	2	3	4
CP 101				
	Pa	100	250	500
	mmH <sub>2</sub> O	10,0	25,0	50,0
	mbar	1,00	2,50	5,00
	inWG	0,40	1,00	2,00
	mmHG	0,80	2,00	4,00
CP 102				
	mmH <sub>2</sub> O	100,0	250,0	500,0
	Pa	1000	2500	5000
	mbar	10,00	25,00	50,00
	inWG	4,00	10,00	20,00
	mmHG	8,00	20,00	40,00
CP 103				
	mbar	100	200	300
	inWG	40,0	80,0	120,0
	Kpa	10,0	20,0	30,0
	PSI	2,0	4,0	6,0
	mmHG	80	160	240
CP 104				
	mbar	500	750	1000
	inWG	200,0	300,0	400,0
	Kpa	50,0	75,0	100,0
	PSI	10,0	15,0	20,0
	mmHG	400	600	800

### Standard range / central zero setting DIP switch 2

To set the type of range, put the on-off switch 4 as shown beside:

Example : standard / 0 (0 / 100 Pa)  
central zero (-50 Pa / 0 / +50 Pa)

Configurations	Full scale	central zero
Combinations		
	1 2 3 4	1 2 3 4

## ■ Initialization of the transmitter

When the transmitter is powered up, it initializes and displays the digits  $\boxed{0.0000}$  and then its configuration including :  
 - the measuring range - the analog output.

### 1- The measuring range

The following message is displayed :  $\boxed{Lo}$ . This is the low value of the measuring range, and its digit value : **ex** :  $\boxed{-500}$ .  
 The following message is displayed :  $\boxed{Hi}$ . This is the high value of the measuring range and its digit value : **ex** :  $\boxed{1000}$ .  
 The arrow displayed (at the bottom or on the right of the screen) is relative to the unit of measurement : **ex** : from -500 to 1000 Pa.

### 2 - The analog output

If the analog output is in 4-20mA, then the following message will appear  $\boxed{4-20A}$ .  
 If the analog output is 0-10 V, then the following message will appear  $\boxed{0-10V}$ .

After the display of the configuration, the transmitter displays  $\boxed{- - - -}$ , which confirms that the initialization is finished and you can start the measurements.

## ■ Configuration via software (with optional LCC100 software)



An easy and friendly configuration with the software !

You can configure your own intermediary ranges.

### ⚠ Caution !

For a pressure transmitter, the minimum configurable range is 10% of the full range.

Example : for a transmitter with a range of 0-1000 Pa, the minimum configurable range is 0-100 Pa.  
 For example, you can configure your transmitter with a range of -20 to +80 Pa, from 0 to +600 Pa, or from -450 to +450 Pa...


### • To access the configuration via software :

- Set the DIP switches as shown beside. **Nota** : the on-off switch 1 of the DIP switch 1 can be in any position (selection of the analogic output 0-10 V or 4-20 mA).
- Connect the cable to the transmitter plug (see "connections").

### • Please refer to the user manual of the LCC 100 to make the configuration.

### ⚠ Caution !

The configuration of the parameters can be done **either with the DIP switch or via software** (you cannot combine both solutions)

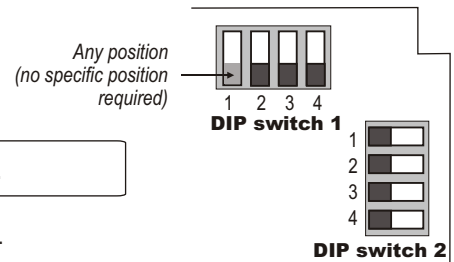


## ■ Mounting

Installation : mount the ABS plate on the wall (this plate is supplied with the transmitter). Drilling :  $\varnothing$  6 mm (with the screws and pins supplied with the transmitter). Insert the transmitter on the plate (see A on the drawing beside) and rotate its housing in clockwise direction until you hear a "click", which confirms that the transmitter is correctly installed.

### ⚠ Caution !

Once the transmitter is installed and powered up, please make an autozero to guarantee the correct working of the transmitter in any position.

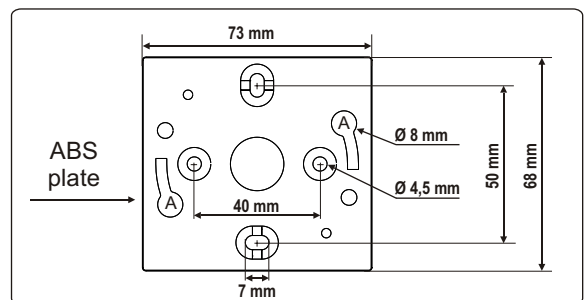

## ■ Maintenance

Please avoid any aggressive solvent.  
 Please protect the transmitter and its probes from any cleaning product containing formol, that may be used for cleaning roots or ducts


## ■ Options

- Power supply class 2, input 230 Vac, output 24 Vac, ref.KIAL-100A
- Configuration software LCC 100 supplied with connection RS 232 cable



## ■ Accessories

- Connection tube
- Connection fittings
- Through-connections
- Straight connections
- Spherical coupling nut



## EXPORT DEPARTMENT

Tel : + 33. 1. 60. 06. 69. 25 - Fax : + 33. 1. 60. 06. 69. 29  
 site : www.kimo.fr e-mail : export@kimo.fr



Distributed by :